



**CPC 1212.9, CMC 1312.9** - Where a sediment trap is not incorporated as a part of the appliance, a sediment trap shall be installed downstream of the appliance shutoff valve as close to the inlet of the appliance as practical, before the flex connector.

**CPC 1212.9, CMC 1312.9** - The sediment trap shall be a tee fitting with a capped nipple in the bottom outlet, as illustrated in Figure 1212.8

**CPC 1212.9, CMC 1312.9** - Sediment trap nipples shall be 3” inches minimum in length.

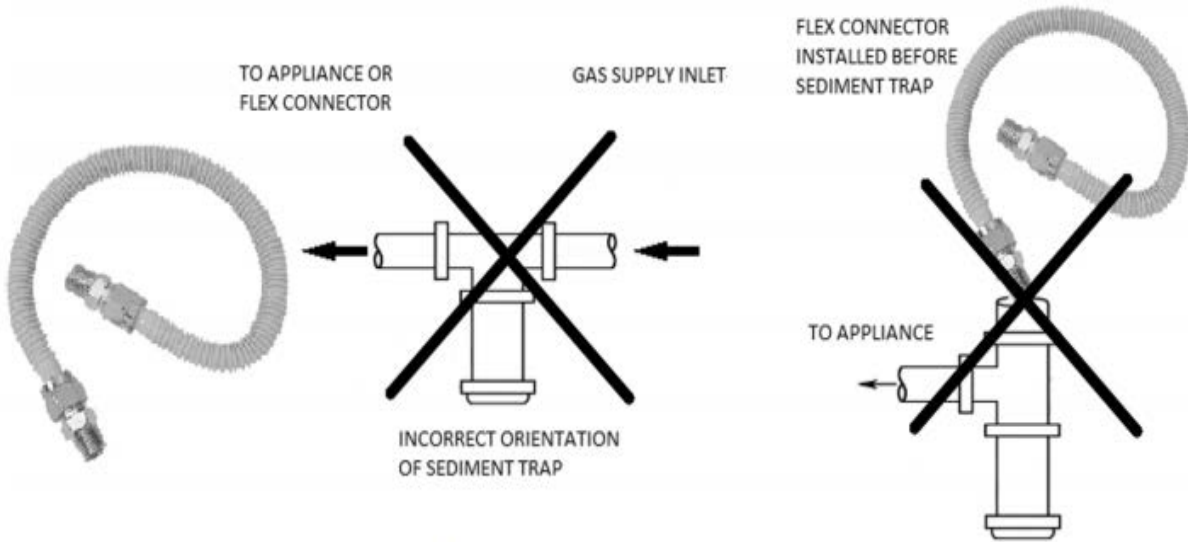

**Figure CPA 065 – Improper Installations of Sediment Trap**

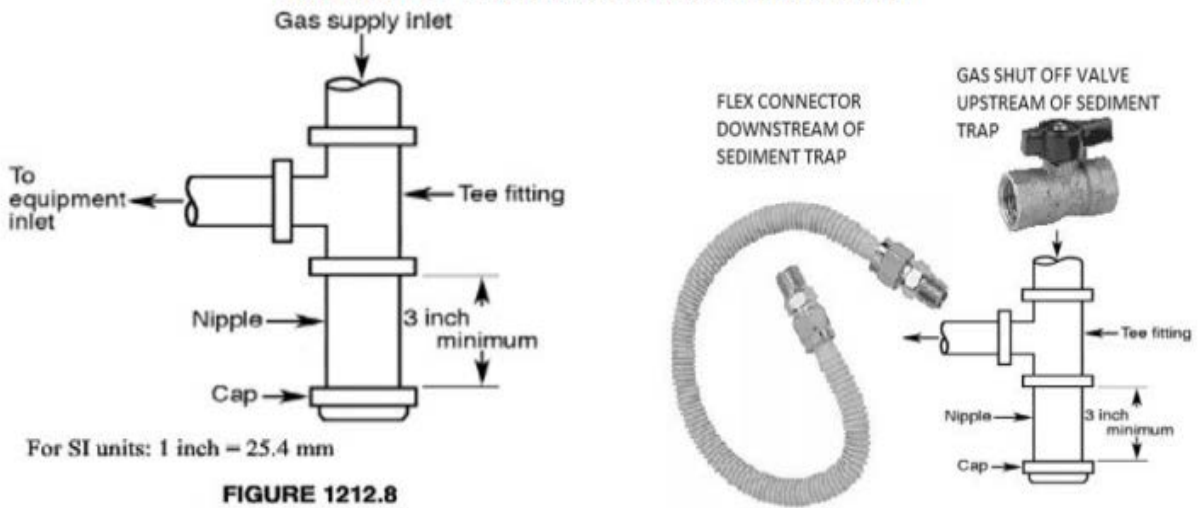

**FIGURE 1212.8  
METHOD OF INSTALLING A  
TEE FITTING SEDIMENT TRAP  
[NFPA 54: FIGURE 9.6.7]**

**Figure CPA 066 – Correct Installation of Sediment Trap**